


ONE PERCENT MINIMUM SLOPE THROUGH DRAINAGE SLAB IS REQUIRED. WHERE A STORM DRAIN LINE IS AVAILABLE IN THE EXTERIOR STREET, A STORM DRAIN INLET AT THE BEGINNING OF THE EASEMENT AND AN 18-INCH MINIMUM STORM DRAIN PIPE IS REQUIRED TO CONVEY NUISANCE WATER THROUGH THE EASEMENT.


NOTE #1: 20' STANDARD WIDTH, DIFFERENT WIDTHS TO BE DESIGNED ACCORDINGLY.

GENERAL NOTE: GATE AND FENCE CONSTRUCTION IS INTENDED TO PREVENT STORAGE OF MATERIALS AND VEHICLES WITHIN CHANNEL. PREVENTION OF PEDESTRIAN USE MAY BE IMPAIRED, BUT THE DESIGN IS NOT INTENDED TO PREVENT PEDESTRIAN TRAFFIC.



BOLLARDS MAY BE USED IN LIEU OF GATE IF PEDESTRIAN ACCESS IS DESIRED.

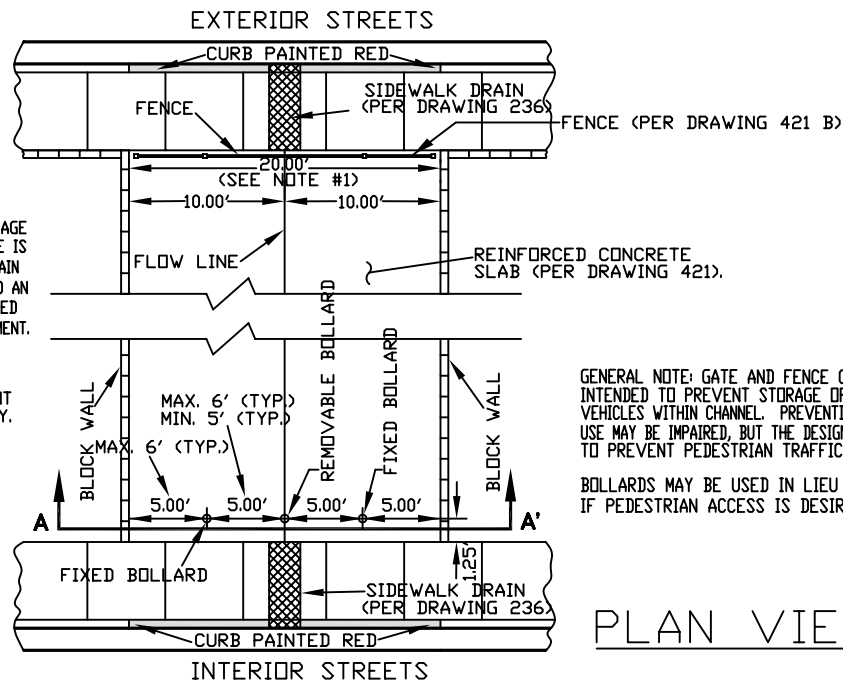

PLAN VIEW

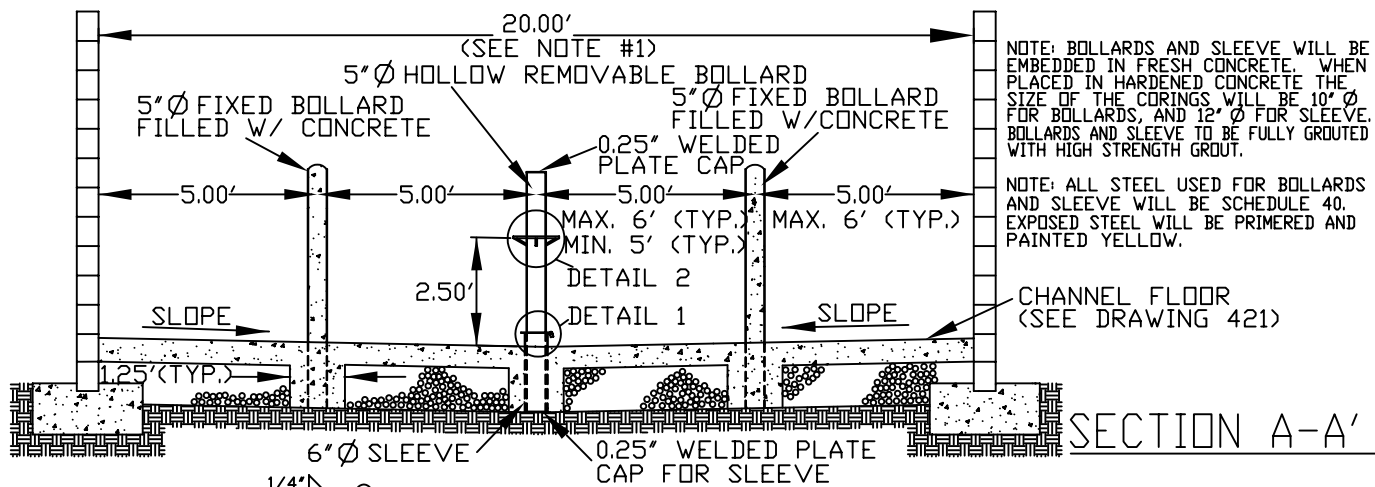

SECTION A-A'

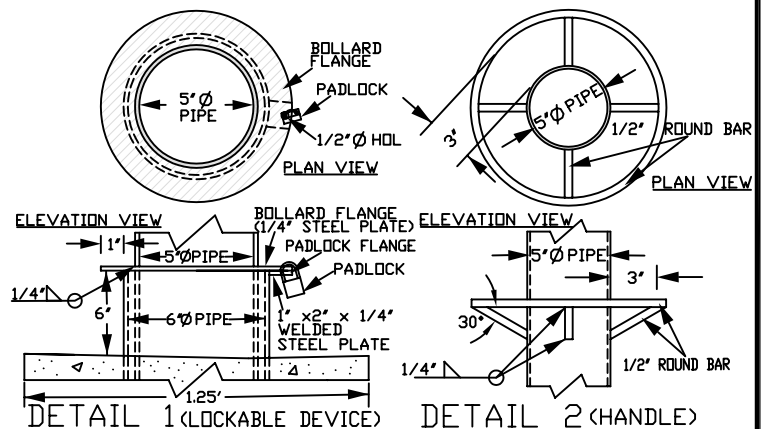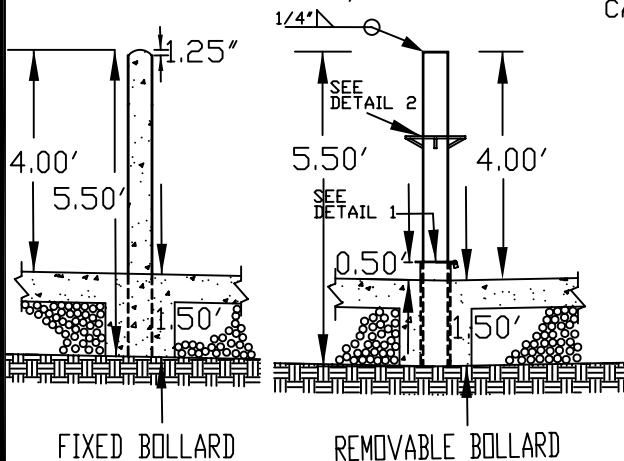

SPECIFICATION REFERENCE

UNIFORM STANDARD DRAWINGS
CLARK COUNTY AREA

CITY OF LAS VEGAS ONLY

THRU-LOT DRAIN
(DETAIL FOR BOLLARDS)

NOT FOR USE IN EMERGENCY ACCESS